



અમદાવાદ મ્યુનિસિપલ કોર્પોરેશન

મહાનગર સેવા સદન, પશ્ચિમ ઝોન (હેલ્થ)

ડૉ. રમણભાઈ પટેલ ભવન, ઉસ્માનપુરા ચાર રસ્તા, અમદાવાદ

ફોન. નં. ૦૭૯-૨૭૫૫૧૨૯૨



હેલ્થ પશ્ચિમ ઝોન
ઇનવર્ડ નં. 439
ઇનવર્ડ તા. 15/5/23
આઉટવર્ડ તા. _____

SAFE DRINKING WATER AND SANITARY CONDITION



CERTIFICATE

CERTIFICATE NO:- 08

Date : 15.05.2023

IT IS CERTIFIED THAT AN INSPECTION TEAM HEADED BY DR. G.T.MAKAWANA (D.Y.H.O WEST ZONE) FROM AHMEDABAD MUNICIPAL CORPORATION INSPECTED THE THE SHETH C.N.ENGLISH MEDIUM SCHOOL, DR.VIKRAM SARABHAI MARG, ELLISBRIDGE, AHMEDABAD ON 05.05.2023 AND FOUND THAT THE THE SHETH C.N.ENGLISH MEDIUM SCHOOL, DR.VIKRAM SARABHAI MARG, ELLISBRIDGE, AHMEDABAD HAS SAFE DRINKING WATER FACILITIES FOR THE STUDENTS AND MEMBERS OF STAFF OF INSTITUTION AND IS MAINTAINING THE HYGIENIC SANITATION CONDITION IN THE SCHOOL BUILDING & THE CAMPUS AS PER THE NORMS PROSCRIBED BY THE CENTRAL / STATE / U.T GOVT.

THE ABOVE VALID FOR A PERIOD OF 08/05/2023 TO 07/05/2024

SIGNATURE WITH SEAL : _____

NAME

: DR. G.T. Makwana

DESIGNATION


: D.Y.H.O WZ AMC

TO,


THE SHETH C.N.ENGLISH MEDIUM SCHOOL,

DR.VIKRAM SARABHAI MARG,

ELLISBRIDGE, AHMEDABAD



AHMEDABAD MUNICIPAL CORPORATION
MAHANAGAR SEVA SADAN
CENTRAL LABORATORY
(An ISO 9001: 2015 Accredited Laboratory)

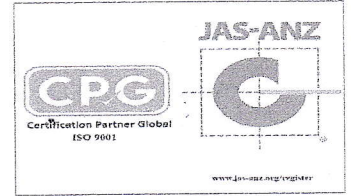

Lic No QAC/R91/4650

Dudheshwar Water Works Compound, Dudheshwar, Ahmedabad-380 004, Gujarat, India
E-mail: centrallab@ahmedabadcity.gov.in, Phone No-(079) 25631105, 25630438.

May 08, 2023.

To,
The Principal,
Sheth C. N. English Medium School,
Vikram Sarabhai Marg,
Ellisbridge, Ahmedabad.

Dear Sir,

We have analyzed your water sample collected on Dt. 05-05-2023 for the following **Chemical and Bacteriological** parameters. The analysis report is as hereunder.

Sr. No.	Parameter	Requirement (Acceptable Limit)	Permissible Limit in the Absence of Alternate Source	Sample Value
		As per IS-10500-2012		
A. Organoleptic and Physical Parameters				
1	Colour, Hazen units, Max	5	15	0.4
2	pH value	6.5-8.5	No relaxation	8.5
3	Turbidity, NTU, Max	1	5	0.1
4	Total dissolved solids, mg/l, Max	500	2000	110
B. General Parameters				
1	Total hardness (as CaCO ₃), mg/l, Max	200	600	60
2	Calcium (as Ca), mg/l, Max	75	200	20
3	Magnesium (as Mg), mg/l, Max	30	100	2.44
4	Chloride (as Cl), mg/l, Max	250	1000	15
5	Sulphate (as SO ₄) mg/l, Max	200	400	9.2
6	Total alkalinity (as CaCO ₃), mg/l, Max	200	600	60
7	Free residual chlorine, mg/l, Min	0.2	1.0	Nil
C. Bacteriological Quality of Drinking Water				
1	Total Coliform bacteria, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detected
2	E. coli, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detected

Remarks:

- The Central Laboratory, AMC, has collected the sample.
- The result contained in this report relate only to the sample material tested.
- The report is not being reproduce wholly or in part and cannot be used as evidence in the court of law and should not be used in any advertising media without our special permission in writing.

NOTE — It is recommended that the acceptable limit is to be implemented. Values in excess of those mentioned under 'acceptable' render the water not suitable, but still 'permissible limit in the absence of alternate source' in column 4, above which the sources will have to be rejected. May be tolerated in the absence of an alternative source but up to the limits indicated.

[Signature]
Scientist In-Charge
Central Laboratory